

ODS-1500

1200...1500 VA DC/AC INVERTER

GENERAL FEATURES:

Sine wave output voltage
 Selectable output frequency: 50/60Hz
 Adjustable output voltage
 High input-output isolation 3000Vrms
 Remote inhibit
 Remote control via RS232
 Alarm by isolated relay contacts
 Remote off opto-coupled
 Optional railway version EN50155
 Fire and smoke: EN45545-2 approved
 Efficiency up to 91%



	12Vdc 10.8 ... 15V	24Vdc 16.8 ... 30V	36Vdc 25.2 ... 45V	48Vdc 33.6 ... 60V	72Vdc 50.4 ... 90V	110Vdc 77 ... 138V
120Vac	ODS-1500-7121 1200 W	ODS-1500-7123 1500 W	ODS-1500-7124 1500 W	ODS-1500-7125 1500 W	ODS-1500-7126 1500 W	ODS-1500-7127 1500 W
230Vac	ODS-1500-7111 1200 W	ODS-1500-7113 1500 W	ODS-1500-7114 1500 W	ODS-1500-7115 1500 W	ODS-1500-7116 1500 W	ODS-1500-7117 1500 W

Several references are subjected to special MOQs and lead times. Please consult Premium's Sales Dept. and web site.

**INPUT**

Input voltage range	-30, +25% Vin nom (10.8 ... 15Vdc for 71X1 models)
Maximum input ripple	5% Vin nom (Vrms, 100Hz)

OUTPUT

Output voltage	120 / 230Vac sinusoidal
Output frequency	50 / 60Hz ± 0.25Hz
Load regulation	< 4%
Line regulation	< 2 % Vin -25% ... +25%, < 10% Vin -30% ... +30% < 4 for 71X1 models
Output wave distortion THD	< 2% (average of 16 samples)
Output HF ripple	< 2.5%

ENVIRONMENTAL

Storage temperature	-25 ... 80°C
Operating temperature full load	-25 ... 55°C(EN50155 OT1)
Operating temperature 62.5% load	-25 ... 70°C(EN50155 OT3)
Relative humidity	5 ... 95%
Cooling	Controlled internal fan
MTBF (MIL-HDBK-217-E; G _b , 25°C)	130.000 h

EMC

Immunity according	EN61000-6-2 (EN50121-3-2)
Emissions according	EN61000-6-4 (EN50121-3-2)

SAFETY

Dielectric strength: Input /output	3000 Vrms / 50Hz / 1min
Dielectric strength: Output / ground	1500 Vrms / 50Hz / 1min
Dielectric strength: Input / ground	500 Vrms / 50Hz / 1min
Safety according to	EN60950-1, EN62368-1
Fire and smoke	EN45545-2 approved

MECHANICAL

Weight	3800 g
--------	--------

PROTECTIONS

Against overloads	Current and I ² T limited (see overload protection)
Against over-temperature	Shutdown with auto-recovery

CONTROL

Output OK LED	Green
Alarm LED	Red
Output failure alarm	Isolated contact relay open when alarm (<0.3A at 150Vdc)
Remote OFF	Off applying 14,4 ... 137.5Vdc, Impedance > 22k5 Ω (See Note-1)
Status and programming	RS232 port


Note-1: Only available depending on HW version. Former models were 4 ... 30V, Impedance 3k3Ω



ORDERING CODES

Model	Input voltage DC [V]	Input voltage range [V]	Output voltage AC [V]	Output current [V]	Active output power [W]	Appar. output power [VA]	Output peak current		Efficien. [%]	No load input current [A]
							5s [Arms]	(Iopk) 10ms [Apk]		
ODS-1500-7111	12	10.8 - 15	230	5.2	1200	1200	6.8	16	87	< 2.0
ODS-1500-7113	24	16.8 - 30	230	6.5	1500	1500	10	16	88	< 1.0
ODS-1500-7114	36	25.2 - 45	230	6.5	1500	1500	10	16	89	< 0.66
ODS-1500-7115	48	33.6 - 60	230	6.5	1500	1500	10	16	90	< 0.45
ODS-1500-7116	72	50.4 - 90	230	6.5	1500	1500	10	16	90	< 0.34
ODS-1500-7117	110	77 - 138	230	6.5	1500	1500	10	16	91	< 0.21
ODS-1500-7121	12	10.8 - 15	120	10.0	1200	1200	13	30	86	< 1.5
ODS-1500-7123	24	16.8 - 30	120	12.5	1500	1500	20	30	88	< 0.80
ODS-1500-7124	36	25.2 - 45	120	12.5	1500	1500	20	30	88	< 0.51
ODS-1500-7125	48	33.6 - 60	120	12.5	1500	1500	20	30	89	< 0.35
ODS-1500-7126	72	50.4 - 90	120	12.5	1500	1500	20	30	89	< 0.28
ODS-1500-7127	110	77 - 138	120	12.5	1500	1500	20	30	90	< 0.16

Several references are subjected to special MOQs and lead times. Please consult Premium's Sales Dept. and web site.

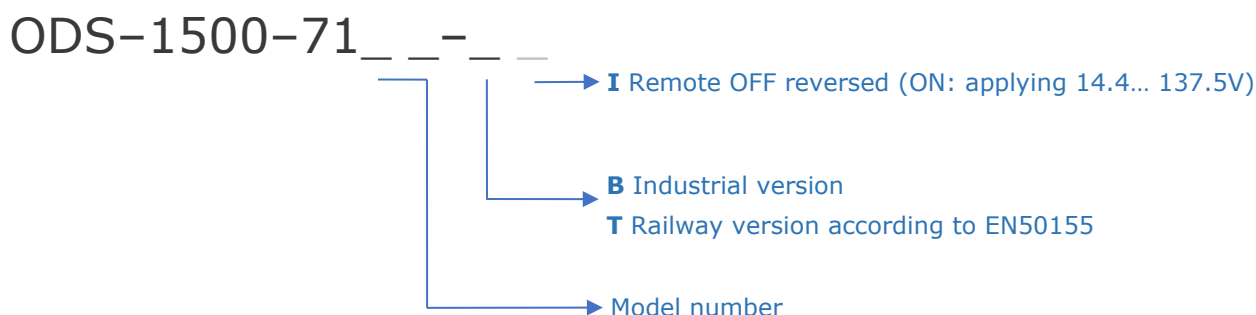


Accessories must be ordered in a separated order line


Note: Grounding bolt implemented recently. Please check with manufacturer to confirm availability of model



BLOCKS DIAGRAM

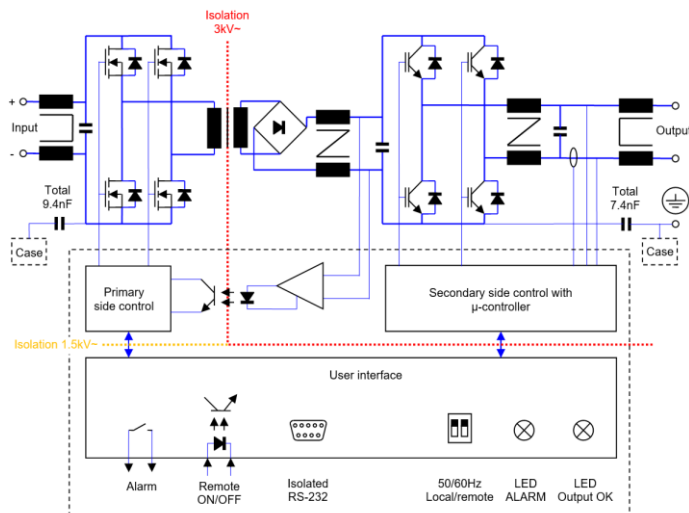


CONNECTIONS

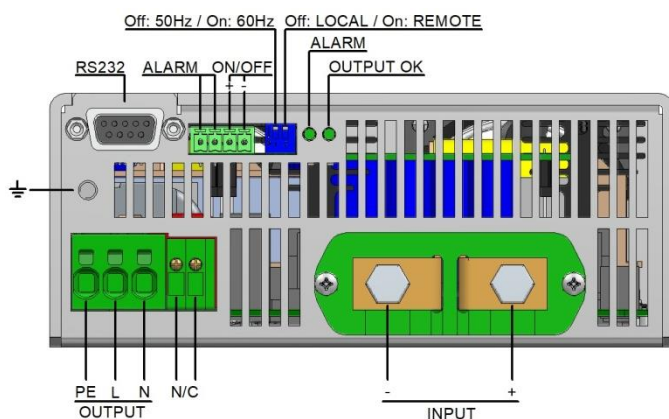

Input	Terminals M6 (Rec. torque 6 Nm)
Output	Cable up to 4 mm ²
Earth	Bolt M5 (Rec. torque 3.8 Nm)
Alarm	Phoenix Contact MC1.5/4-G-3.81
ON/OFF	(See accessories)
RS232	DB9
N/C	Do not use

POWER DERATING vs AMBIENT TEMPERATURE

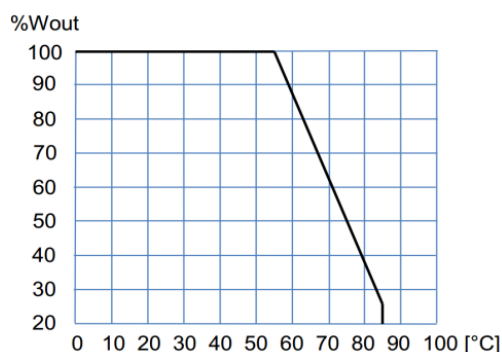

DESCRIPTION

The ODS-1500 consists of single phase sine-wave DC/AC inverters with galvanic isolation between input and output

The unit allows:

- Select 50 / 60Hz by means of DIP-switch.
- Select local / remote (RS-232) by means of DIP-switch
- Shutdown applying voltage on pins 3 and 4 of signal connector
- Local signalization of Output OK by means of green LED
- Local alarm. Red LED ON when:
 - Output voltage is not OK
 - Output current > OUTPUT CURRENT ALARM
 - Input voltage out of margins
 - Unit shutdowns by over-current or remote OFF
- Alarm. Open contacts when output voltage is not OK
- Set and monitor parameters via RS-232.

The ODS-1500 are equipped with a maximum average power protection as well as maximum output peak current protection. This protects the unit even when an output short-circuit occurs. It also features a disable function for input under-voltage, which allows protecting the batteries from harmful discharges.

INSTALLATION

- The unit has 6 threaded holes for the fixation on a mounting surface.
- The unit has internal fans. For an appropriate cooling, the air input and output should be free of elements that cause and an air flow reduction (minimum recommended distance to other objects 50mm).
- Make connections as shown in the figure.
- The default output frequency is 50Hz. For 60Hz simply actuate the dip-switch as indicated in the figure.

For safety reasons, the following requirements must be met:

- Provide the equipment with some kind of protective enclosure that complies with the electrical safety directives in effect within the country where the equipment is installed.
- Include an input fuse with a rating immediately higher than the maximum input current.
- Use cables of adequate cross-section to connect inputs and outputs. The following table lists the maximum currents and the minimum cross-sections for the cables used for each power connection.

	Input 12V	Input 24V	Input 36V	Input 48V	Input 72V	Input 110V	Output 120V	Output 230V
Max. current	140 A	100 A	75A	50 A	33 A	22 A	13 A	6.7 A
Cable cross-section	35 mm ²	16 mm ²	16 mm ²	10 mm ²	6 mm ²	2.5 mm ²	1.5 mm ²	1.0 mm ²

RS232 Functions	Monitor	Set
	Input voltage	Input under-voltage lockout
	Output voltage	Input under-voltage alarm
	Output current	ON / OFF
	Internal temperature	Output frequency
	Output frequency	Maximum output current
	Output power	Output voltage



RS232 communication port

It is possible to control and monitor de unit via RS232 by means a terminal emulator like "Tera Term" or "Putty"

Also it is possible to control and monitor de unit directly using the protocol showed in table:



A null modem F-M is required

Protocol configuration: ASCII code, 19200 bauds, parity none, 8 bits, 1bit stop


Header	Function	Parameter	Returns	Explanation
P	R	L	V	PTV■■■■.■ Input voltage in Volts
			U	PTU■■■■.■ Output voltage in Volts RMS
			I	PTI■■■■.■ Output current in Amps RMS
			T	PTT■■■■.■ Internal temperature in °C
			F	PTF■■■■.■ Output frequency in Hz
			W	PTW■■■■ Output power in W
			S	PTS■■■■.■ Inverter state 999.9→ Inverter enabled 000.0→ Inverter disabled 222.2→ Inverter blocked by overload 111.1→ Inverter blocked by overload or short-circuit
			M	PTM■■■■ Model number
			R	PTR■■■■ Firmware version
			Other character	PTE Command not supported
		G	1 ■■■.■	OK Set the minimum input working voltage in Volts
				ERR Value NO VALID for this parameter
			2 ■■■.■	OK Set the minimum alarm input voltage in Volts (it should be higher than PRG1)
				ERR Value NO VALID for this parameter
			3 ■■■.■	OK Changes the status bit (after start-up enabled with SW3 =LOCAL and disabled with SW3 =REMOTE) 999.9→ Inverter enabled 000.0→ Inverter disabled
				ERR Value NO VALID for this parameter
			4 ■■■.■	OK Set the output voltage in Volts RMS $80\% V_{nom} \leq \text{■■■■.} \leq 105\% V_{nom}$
				ERR Value NO VALID for this parameter
			5 ■■■.■	OK Set the maximum output current in Amps $20\% I_{nom} \leq \text{■■■■.} \leq 100\% I_{nom}$
				ERR Value NO VALID for this parameter
			6 ■■■.■	OK Changes the output frequency (it's not stored for the next start-up) 050.0→ 50Hz 060.0→ 60Hz
				ERR Value NO VALID for this parameter
			7 ■■■.■	OK Set the OUTPUT CURRENT ALARM $0 \leq \text{■■■■.} \leq 100\% I_{max_warning}$
				ERR Value NO VALID for this parameter
			8 ■■■.■	OK 111.1→ Reset the inverter
				ERR Value NO VALID for this parameter
			A ■■■.■	OR Set the start-up voltage in volts (it should be higher than PRG1)
				ERR Value NO VALID for this parameter



WORKING PARAMETERS


Thermal protection	71XX						
Internal warning temperature	88						°C
Internal shutdown temperature	92						°C
Internal restart temperature after over-temperature shutdown	75						°C
Input voltage parameters	71X1	71X3	71X4	71X5	71X6	71X7	
Max. input voltage shutdown instantaneous	16.8	33.7	50.6	67.3	100.9	154.1	Vdc
Max. input voltage shutdown timed 0.1s	15.1	30.1	45.2	60.1	90.1	138.6	Vdc
Maximum star-up voltage	14.9	29.9	44.9	59.8	89.7	137.4	Vdc
Minimum star-up voltage	10.6	17.9	26.9	35.9	53.9	82.4	Vdc
Min. input voltage shutdown timed 0.1s	10.0	16.7	25.1	33.5	50.3	76.9	Vdc
Min. input voltage shutdown instantaneous	9.6	14.4	21.6	28.7	43.1	65.9	Vdc
Output voltage parameters	711X			712X			
Output voltage of short circuit or deep overload	< 164			< 86			Vac
Time of short-circuit	1000						ms
Time of start-up after shutdown by short-circuit	2000						ms
Number of start-up attempts after short circuit	5						
Output current parameters	7111	7113/4/5/6/7		7121	7123/4/5/6/7		
Maximum continuous output current	5.3	6.6		10.1	12.7		A
Warning current	5.2	6.5		10	12.5		A
Start-up time after shutdown by overload	1000	1500		1000	2000		ms
Maximum overload I²t	See figure below						
Number of attempts of consecutive overload	5						
Start-up and working errors	71XX						
Maximum time for overload or internal failure	unlimited						
Minimum time required between disconnection and next connection	2						min

OVERLOAD PROTECTION

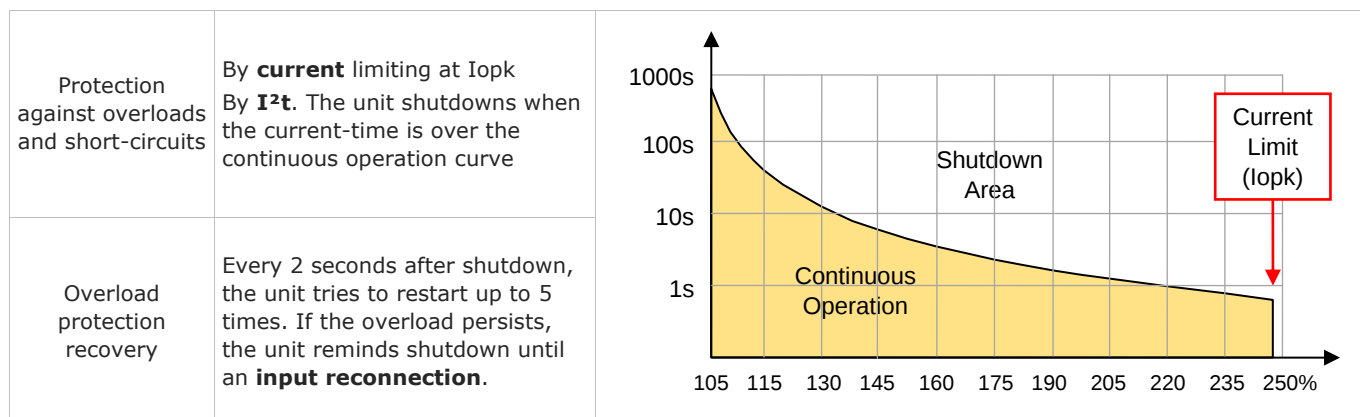




DIMENSIONS

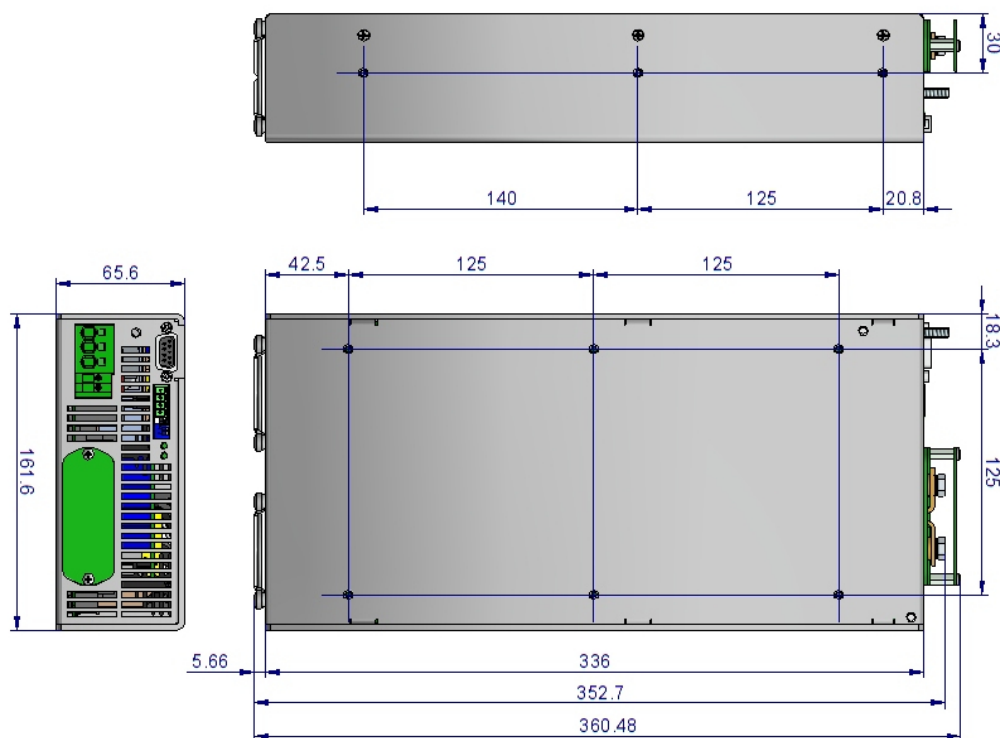

Fixing screws of the base: 6 x M4, maximum penetration depth 3.5mm

ACCESSORIES

DESCRIPTION	NOTES	CODE
Mounting brackets kit	Contains two brackets and screws	NP-9282
DIN rail assembly kit	Screws included	NP-9339
2U 19" rack mounting tray kit	It allows to install one or two units	NP-9353
Signals female connector	Phoenix contact MC1.5/4-ST-3.81	2601-409

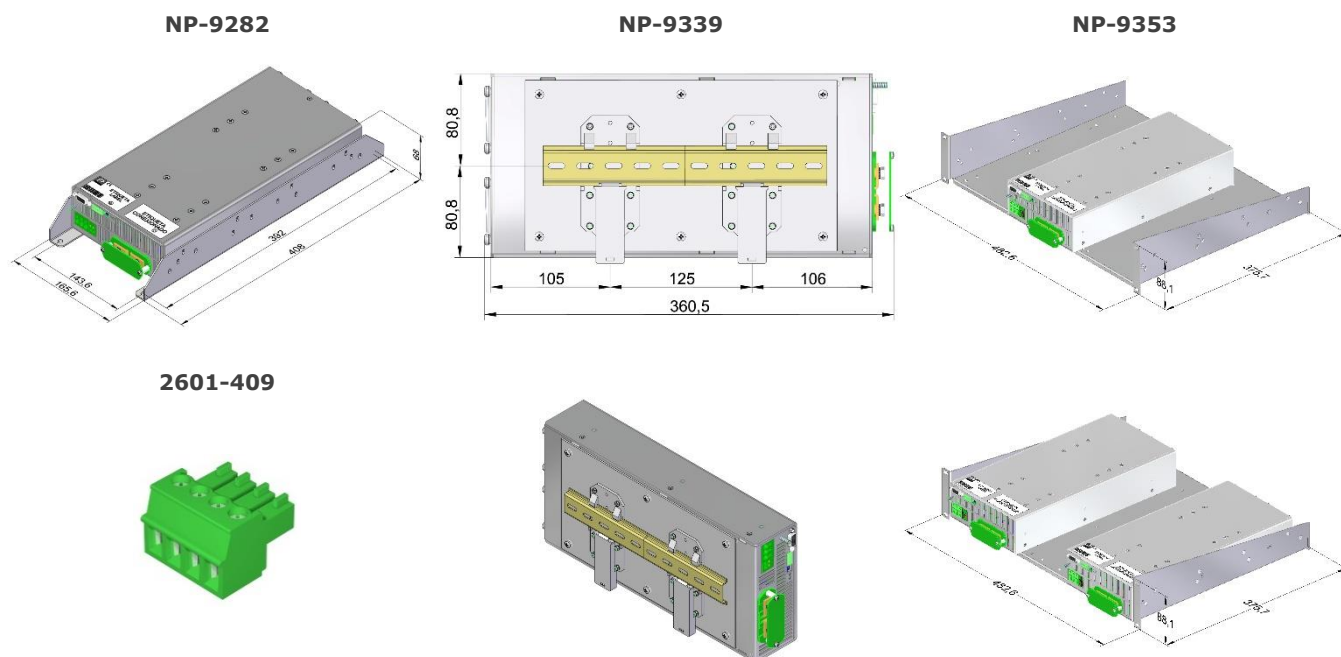

EU, UKCA DECLARATION OF CONFORMITY



The undersigned, representing the following:

Manufacturer: PREMIUM, S. A.,
Address: C/ Dolors Aleu 19-21, 08908 L'Hospitalet de Llobregat, SPAIN

herewith declares that the product:

Type: DC/DC converter
Models: **ODS-1500-7111 ... 7127**

is in conformity with the provisions of the following EU directive(s):

2014/35/EU SI 2016 No 1101	Low voltage / The electrical equipment (safety) regulations
2014/30/EU SI 2016 No 1091	EMC / Electromagnetic compatibility regulations
2011/65/EU Annex II and its amendment 2015/863/EU SI 2012 No. 3032	RoHS / Restriction of the use of certain hazardous substances in electrical and electronic equipment

and that standards and/or technical specifications referenced below have been applied:

EN 60950-1: 2005	Safety. Information technology equipment
EN 62368-1: 2014	Safety. Audio/video information and communication technology equipment
EN 61000-6-3: 2007	Generic emission standard
EN 61000-6-2: 2005	Generic immunity standard
EN 50155: 2017*	Railway applications. Electronic equipment used on rolling stock material
EN 50121-3-2: 2016*	Railway applications. EMC Rolling stock equipment

* Optional, See annexe

CE marking year: **2010**; UKCA marking year: **2021**

Notes:

For the fulfilment of this declaration the product must be used only for the aim that has been conceived, considering the limitations established in the instructions manual or datasheet.

L'Hospitalet de Llobregat, 31-05-2021

Albert Sole
Technical Director

PREMIUM S.A. is an ISO9001 and ISO14001
certified company by **Bureau Veritas**

ANNEXE

Applicable values for the different sections of the norm EN50155: 2017							
4.3.1	Working altitude	Up to 2000m					
4.3.2	Ambient temperature	Class OT1 (-25 to 55°C): load < 100% Class OT2 (-40 to 55°C): load < 100% (Without connectors handling) Class OT3 (-25 to 70°C): load < 62.5% Class OT4 (-40 to 70°C): load < 62.5% (Without Connectors handling)					
4.3.3	Switch-on extended operating temp.	ST1					
4.3.4	Rapid temperature variations	H1					
4.3.5	Shocks and vibrations	According EN61373:2010 Category 1 class B					
4.3.6	EMC Electromagnetic Compatibility EN50121-3-2:2016						
		Test	Norm	Port	Frequency	Limits	
		Radiated emissions	IEC55016	Case	30MHz...230MHz	40dB(μV/m) Qpk at 10m	
					230MHz...1GHz	47dB(μV/m) Qpk at 10m	
					1...3GHz	Do not apply	
		Conducted emissions	IEC55016	Input	3...6GHz	Internal freq. < 108MHz	
					150kHz...500kHz	99dB(μV) Qpk	
					500kHz...30MHz	93dB(μV) Qpk	
		Test	Norm	Port	Severity	Conditions	P
		Electrostatic discharge	IEC61000-4-2	Case	±8kV	Air (isolated parts)	B
					±8kV	Contact (conductive parts)	
		Radiated high-frequency	IEC61000-4-3	X/Y/Z Axis	20V/m	0.08...1.0GHz M. 80% 1kHz	A
					10V/m	1.4...2.1GHz M. 80% 1kHz	
					5V/m	2.1...2.5GHz M. 80% 1kHz	
					3V/m	5.1...6Ghz M. 80% 1kHz	
		Fast transients	IEC61000-4-4	Input	±2kV	Tr/Th: 5/50 ns	A
				Output	±2kV		
Signal	±2kV						
PE	±1kV						
Surge	IEC61000-4-5	Input L to L	±1kV	Tr/Th: 1.2/50μs	B		
		Input L to PE	±2kV				
Conducted RF	IEC61000-4-6	Input	10V	0.15...80MHz M. 80% 1kHz	A		
		Output	10V				
		Signal	10V				
		PE	10V				
Magnetic field	IEC61000-4-8	X/Y/Z Axis	300A/m	0Hz, 16.7Hz, 50/60Hz	A		
P= Performance criteria, L= Line, PE= Protective Earth							
4.3.7	Relative humidity	Up to 95%					
5.1.1.2	DC power supply range	From 0.70 to 1.25 Un continuous					
5.1.1.3	Temporary DC power supply fluctuation	From 0.60 to 1.40 Un 0.1s From 1.25 to 1.40 Un 1s without damage					
5.1.1.4	Interruptions of voltage supply	Class S1 (without interruptions)					
5.1.1.6	Input ripple factor	10% peak to peak with a DC Ripple Factor of 5 %					
5.1.3	Supply change-over	0.6 Un duration 100 ms (without interruptions). Performance criterion A					
7.2.7	Input reverse polarity protection	By external fuse					
10.7	Protective coating for PCB assemblies	Class PC2					
13.3	Tests list	1 Visual Inspection 2 Performance test 3 Power supply test 4 Insulation test 5 Low temperature storage test 6 Low temperature start-up test 7 Dry heat test 8 Cyclic damp heat test 9 Salt mist test 10 Enclosure protection test (IP code) 11 EMC test 12 Shocks and vibrations test 13 Equipment stress screening test 14 Rapid Temperature variation test		Routine Routine Routine Routine - Type Type Type - - Type Type Routine: 40°C and load 100% Type			

Authorised, valued-added distributor

Australia & New Zealand



Powerbox Australia Pty Ltd

Sydney Head Office
4 Beaumont Road,
Mt Kuring-Gai, NSW 2080
Australia



1800 251 380



sales@powerbox.com.au



powerbox.com.au

Powerbox Pacific Ltd

New Zealand Sales Office
1a Henry Rose Place,
Albany, Auckland
New Zealand 0632



09 4158 320



sales@powerbox.co.nz



powerbox.co.nz